


TRANSVERSE SECTIONS OF WALLS OF THE FIRST, OR DWELLING-HOUSE CLASS, ACCORDING TO THE DESCRIPTIONS OF THEIR THICKNESSES IN SCHEDULE (C.)—PART II.

FIRST RATE.

SECOND RATE.

THIRD RATE.

FOURTH RATE.

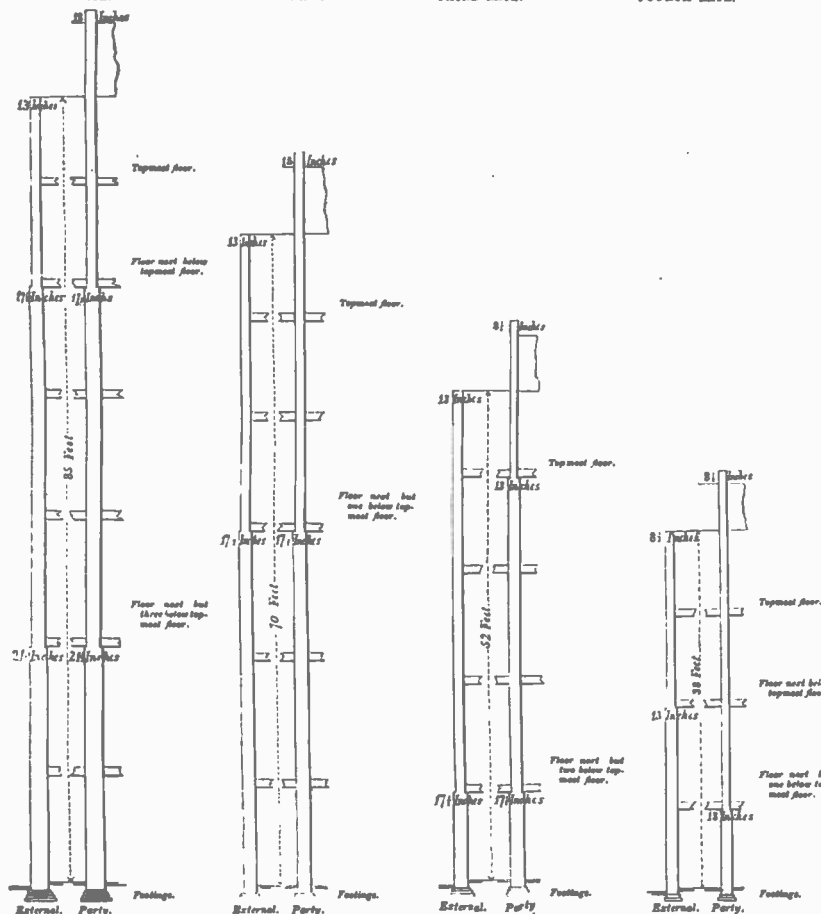

SCHEDULE (C.)—PART III.—CONDITIONS for determining the Rates to which Buildings of the Second or Warehouse Class are to be deemed to belong, and the thickness of the External Walls and of the Party Walls thereof.

In reference to Height.	Rate of Building.	Requisite thickness of the External Walls of each Rate of the Second Class.	Requisite thickness of the Party Walls of each Rate of the Second Class.
1. If the building be in height the first rate of more than 66 feet,	It is to be of the first rate of more than 66 feet.	And the thickness of the external walls must be, at the least, 26 inches from the top of the footing up to the level of 76 feet below the topmost ceiling; and, at the least, 21½ inches from the level of 76 feet below the topmost ceiling up to the level of 36 feet below the topmost ceiling; and, at the least, 17½ inches from the level of 36 feet below the topmost ceiling up to the top of the wall.	And the thickness of the party-walls must be, at the least, 26 inches from the top of the footing to the level of 76 feet below the topmost ceiling; and, at the least, 21½ inches from the level of 76 feet below the topmost ceiling up to the level of 36 feet below the topmost ceiling; and, at the least, 17½ inches from the level of 36 feet below the topmost ceiling up to the level of the topmost ceiling; and, at the least, 13 inches from the level of the topmost ceiling up to the top of the wall.
2. If more than 44 feet and not the first rate of more than 66 feet,	It is to be of the second rate of more than 44 feet.	And the thickness of the external walls must be, at the least, 21½ inches from the top of the footing up to the level of 58 feet below the topmost ceiling; and, at the least, 17½ inches from the level of 58 feet below the topmost ceiling up to the level of 22 feet below the topmost ceiling; and, at the least, 13 inches from the level of 22 feet below the topmost ceiling up to the top of the wall.	And the thickness of the party-walls must be, at the least, 21½ inches from the top of the footing up to the level of 58 feet below the topmost ceiling; and, at the least, 17½ inches from the level of 58 feet below the topmost ceiling up to the level of 22 feet below the topmost ceiling; and, at the least, 13 inches from the level of 22 feet below the topmost ceiling up to the top of the wall.
3. If more than 22 feet and not the second rate of more than 44 feet,	It is to be of the third rate of more than 22 feet.	And the thickness of the external walls must be, at the least, 17½ inches from the top of the footing up to the level of 28 feet below the topmost ceiling; and, at the least, 13 inches from the level of 28 feet below the topmost ceiling up to the top of the wall.	And the thickness of the party-walls must be, at the least, 17½ inches from the top of the footing up to the level of 28 feet below the topmost ceiling; and, at the least, 13 inches from the level of 28 feet below the topmost ceiling up to the level of the topmost ceiling; and, at the least, 8½ inches from the level of the topmost ceiling up to the top of the wall.
4. If not more than 22 feet,	It is to be of the fourth rate of not more than 22 feet.	And the thickness of the external walls must be, at the least, 17½ inches from the top of the footing up to the level of 9 feet below the topmost ceiling up to the top of the wall.	And the thickness of the party-walls must be, at the least, 13 inches from the top of the footing up to the level of 16 feet below the topmost ceiling up to the top of the wall.